


Schematic Diagram

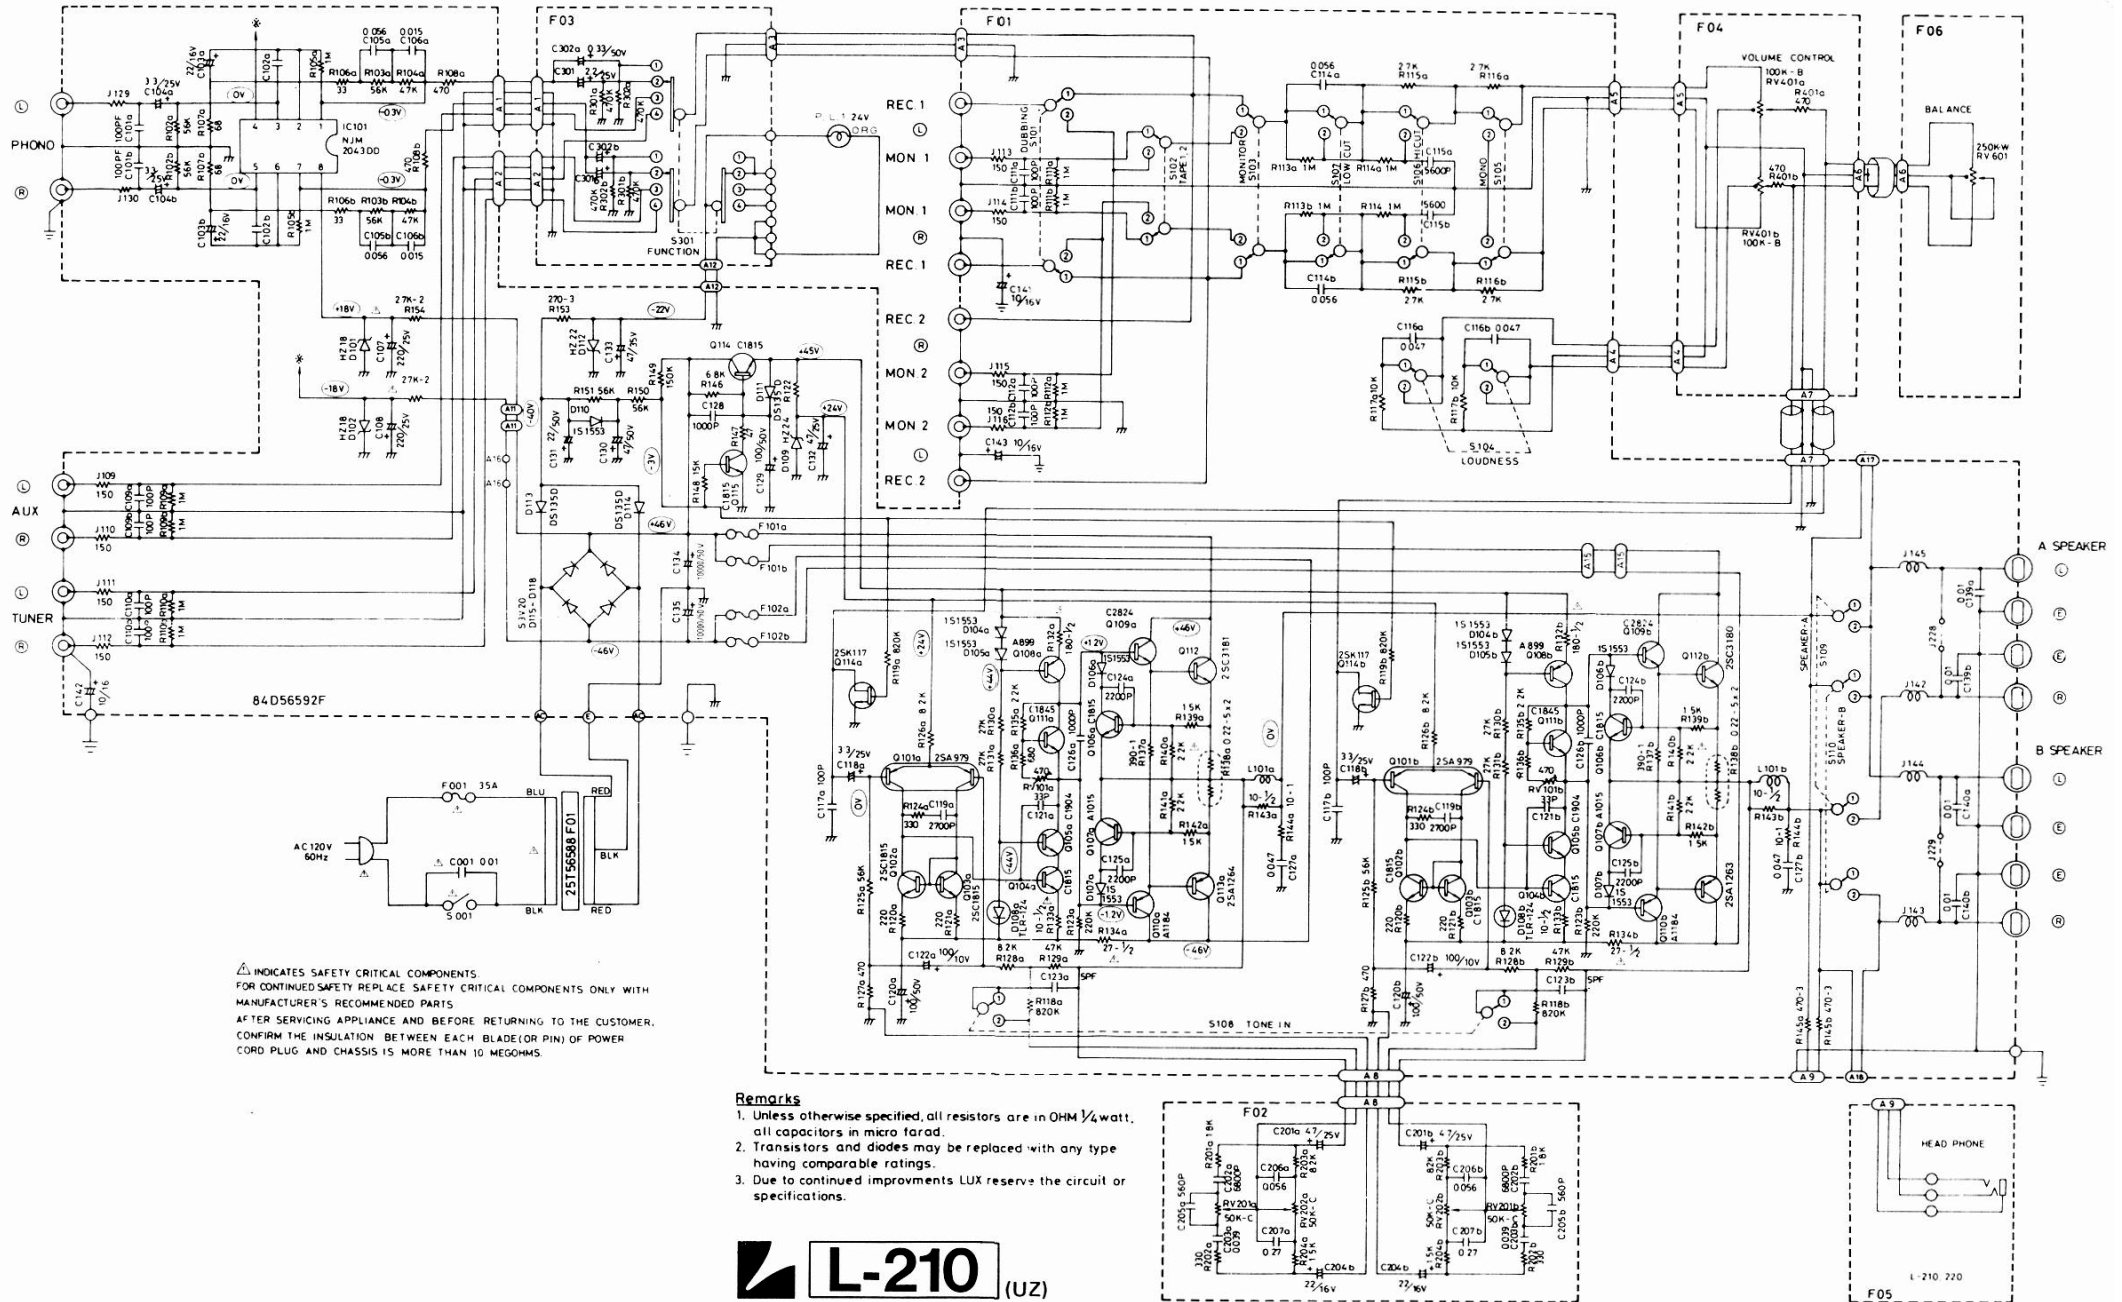

△ INDICATES SAFETY CRITICAL COMPONENTS.
 FOR CONTINUED SAFETY REPLACE SAFETY CRITICAL COMPONENTS ONLY WITH
 MANUFACTURER'S RECOMMENDED PARTS.
 AFTER SERVICING APPLIANCE AND BEFORE RETURNING TO THE CUSTOMER,
 CONFIRM THE INSULATION BETWEEN EACH BLADE (OR PIN) OF POWER
 CORD PLUG AND CHASSIS IS MORE THAN 10 MEGOHMS.